



Putere absorbita	50 kW
Putere instalata	64 kW
Tensiune	0,4 kW
Mod tratare nul	TN-S

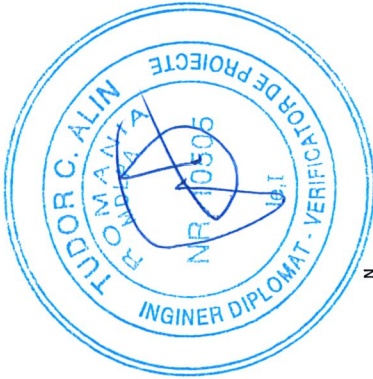

Device Identification	IG	DST	TCT-1	TCT-2	TCT-3	TCT-4	TCT-5	TCT-6	TCT-7
Description	Interrupator general tablou TCT -sosiire de la TG	Descarcator la supratensiuni atmosferice	Illuminat de securitate pentru interventii	Alimentare ventiloconvectoare	Alimentare ventiloconvectoare	Alimentare ventiloconvectoare	Alimentare ventiloconvectoare	Alimentare ventiloconvectoare	Alimentare ventiloconvectoare
Power	64 kW / 50 kW	-	0,3 kW	0,3 kW	0,3 kW	0,3 kW	0,3 kW	0,4 kW	0,4 kW
Cable sections	4x50+25 mmp	-	3x1,5 mmp	3x2,5 mmp	3x2,5 mmp	3x2,5 mmp	3x2,5 mmp	3x2,5 mmp	3x2,5 mmp
Cable type	N2XH	-	N2XH	N2XH	N2XH	N2XH	N2XH	N2XH	N2XH

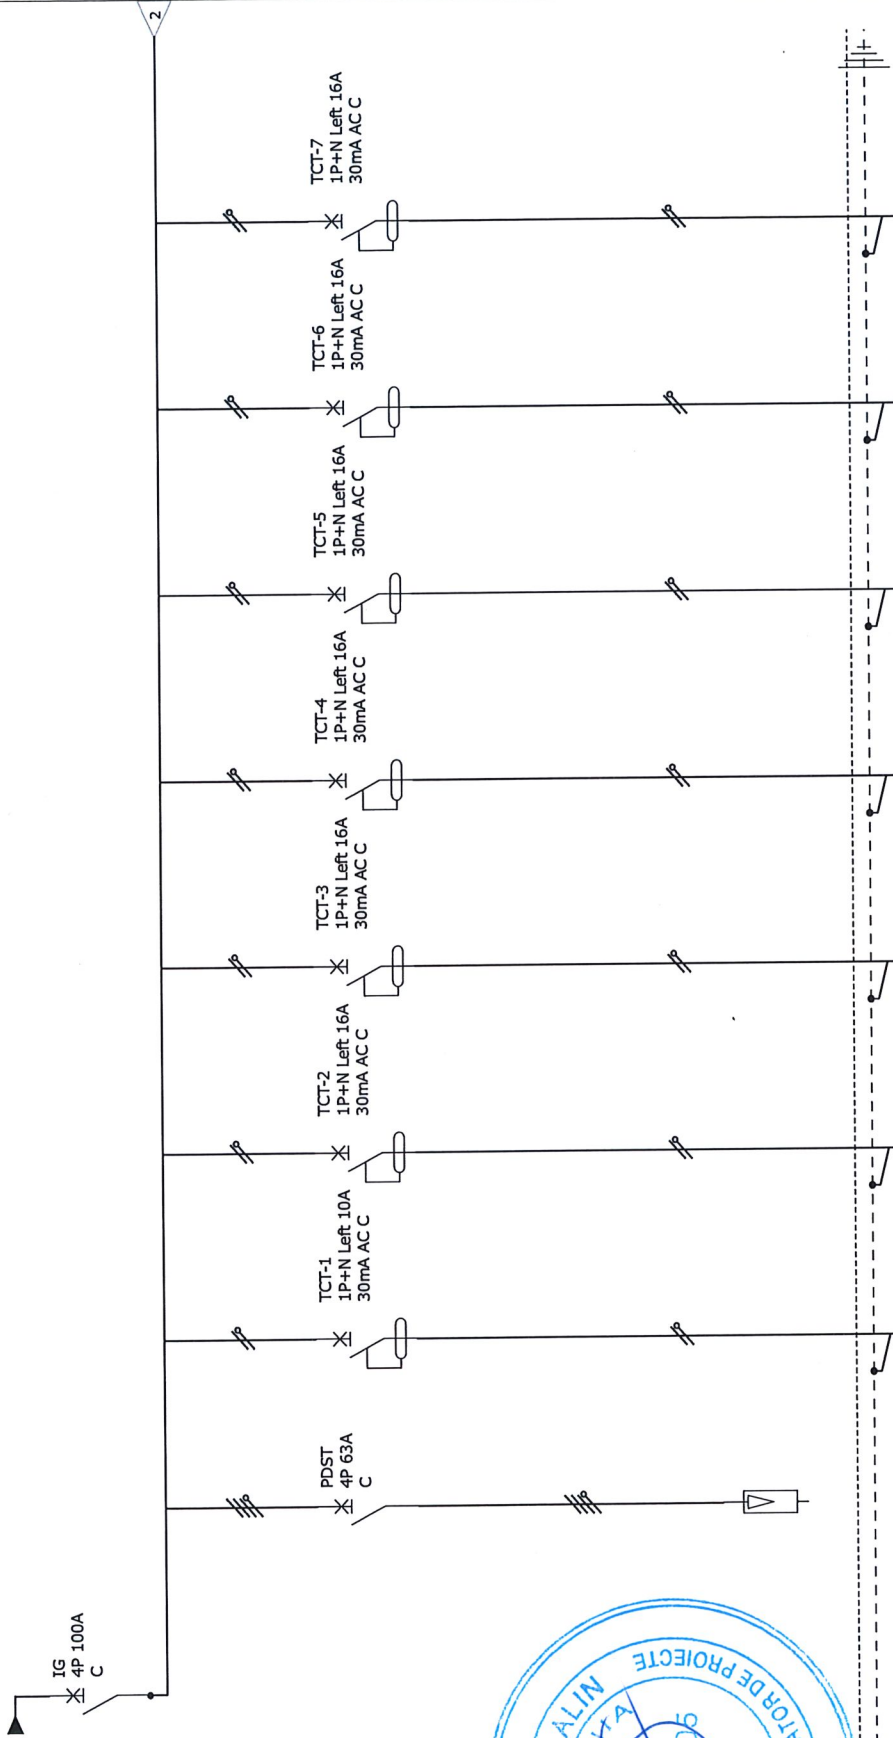

CONSTRUIRE CENTRU MULTIFUNCTIONAL SANMIHAIU ROMAN



eld.ro

ISO9001:2015

Proiect nr. :	ELDD-CT-083	Sef proiect :	ing. Razvan Popa
Plansa nr. :	E-05	Proiectat :	ing. Alexandra Batea
Data :	14/10/2024	Desenat :	ing. Alexandra Batea

E-05 Tablou electric TCT